

TOWN OF FORT FRANCES
Operations and Facilities Division - Environmental Area - Operations Statistics
(September 2018)

STAFFING:

See Operations Statistics (September) 2018 prepared by M. Strachan, Superintendent of Transportation

OVERTIME HOURS - Equivalent Straight Time Hours

See Operations Statistics (September) 2018 prepared by M. Strachan, Superintendent of Transportation

WATER DISTRIBUTION & WASTE WATER COLLECTION:

See Monthly Summary (Attached)

WATER TREATMENT PLANT:

September, 2018 - In receipt of the Water Treatment Plant Monthly Report

WASTE-WATER TREATMENT FACILITY:

September, 2018 - In receipt of the Wastewater Treatment Facility Monthly Report.

WASTE MANAGEMENT:

Garbage Collection:

- Number of complaints regarding garbage collection:
 - Town - 0 complaints, Asselin's - 0 complaints

Sanitary Landfill (Waste Disposal Site):

Landfill Scales functioning during this period.

- Amount of residential waste delivered to the landfill:
 - 245753 kg
- Amount of ICI waste delivered to the landfill:
 - 392450 kg

Recycling:

- Number of complaints regarding recycled materials:
 - Town - 0 complaints, Asselin's - 0 complaint
- Amount of recycled waste diverted from the landfill:
 - (No data) Emterra

Prepared By: Craig Miller



11/30/18

Environmental Superintendent


Date:

Monthly Summary for September 2018

Location	Date	Main System	Subcategory	Remarks	Billable	Done By
Second Street E - 320	1-Sep-18	Sewer	Plugged Sewers	Blockage let go @ 60' on town property - min bill	Yes	D. Martin, E. Gustafson
				Hit blockage @ 60ft & bent cable. Used other machine but could not get thru 60-70 ft. but water started to flow. Service possibly tied into 312 armit.	Yes	G. Wiedenhoef / J. Bruyere
Arnall Ave - 314	4-Sep-18	Sewer	Plugged Sewers			
Scott St. - 325	5-Sep-18	Water	Curb Stop Box Adjustments	Replaced box and rod; raised to grade	No	B. Patterson / J. Nicolay
Scott St. - 335	5-Sep-18	Water	Curb Stop Box Adjustments	Replaced box and rod; raised to grade	No	B. Patterson / J. Nicolay
Scott St. - 339	5-Sep-18	Water	Curb Stop Box Adjustments	Raised c/s to grade	No	B. Patterson / J. Nicolay
Scott St. - 343	5-Sep-18	Water	Curb Stop Box Adjustments	Vac'd, replaced c/s box, rod and top. Raised to grade	No	B. Patterson / J. Nicolay
Scott St. - 353	5-Sep-18	Water	Curb Stop Box Adjustments	Raised c/s to grade	No	B. Patterson / J. Nicolay
Scott St. - 375	5-Sep-18	Water	Curb Stop Box Adjustments	Raised c/s to grade	No	B. Patterson / J. Nicolay
					No	B. Patterson, J. Bruyere, G. Wiedenhoef
Corwall Ave - 1036	6-Sep-18	Water	New Water Service Installations	CCTV & connection Inspection for Sewer and Water	Yes	
Minnie Ave - 201	6-Sep-18	Water	Water Turn Off/On	Turn water off @ 9/6 - 1pm; on @ 9/11 - 1:15pm	Yes	G. Wiedenhoef / J. Bruyere
Third Street W - 638	7-Sep-18	Water	Curb Stop Box Adjustments	Lowered c/s to grade	No	B. Patterson / J. Nicolay
Third Street E - 1228	7-Sep-18	Water	Water Turn Off/On	Turn water on @ 1pm	Yes	G. Wiedenhoef
Victoria Ave - 308	7-Sep-18	Water	Water Turn Off/On	Turn water on @ 3:30pm	Yes	B. Patterson
				total of 8 hours for meetings, tracing water main, connection inspections, water turn off/on, backflow test.	Yes	J. Bruyere, G. Wiedenhoef
SGEI	11-Sep-18	Other	Private Work			
Scott St. - 397	12-Sep-18	Water	Curb Stop Box Adjustments	Replaced box and rod; raised to grade	No	B. Patterson / J. Nicolay
Christie Ave N - 934	13-Sep-18	Water	New Water Service Installations	Connection Inspection for Sewer and Water	Yes	G. Wiedenhoef
Idylwild Drive - 1201	14-Sep-18	Other	Private Work	Trace water service on property	Yes	J. Bruyere, G. Wiedenhoef
Second Street E - 322	14-Sep-18	Sewer	Plugged Sewers	Hit blockage @ 8ft. Nothing back on knives. History of roots.	Yes	G. Wiedenhoef / J. Bruyere
Corwall Ave - 1009	14-Sep-18	Water	Curb Stop Box Adjustments	Lowered c/s to grade	No	B. Patterson / J. Nicolay
Scott St. - 310	14-Sep-18	Water	Curb Stop Box Adjustments	Replaced c/s box and rod. Thaw wire to NW of c/s.	No	G. Wiedenhoef / J. Nicolay
Smith Ave - 918	17-Sep-18	Other	Private Work	CCTV existing sewer - town side is good. Roots on property side.	Yes	J. Nicolay, J. Bruyere
				Cut down box, replaced top and buried. Service no longer in use.		
Fifth Street W - 214	17-Sep-18	Water	Curb Stop Box Adjustments	Cut down box, replaced top and buried. Service no longer in use.	No	J. Bruyere / J. Nicolay
Fifth Street W - 216	17-Sep-18	Water	Curb Stop Box Adjustments		No	J. Bruyere / J. Nicolay
Nelson St. - 508	17-Sep-18	Water	Curb Stop Box Adjustments	Cut box and lowered curb stop top.	No	J. Bruyere / J. Nicolay
Arnall Ave - 327	17-Sep-18	Water	New Water Service Installations	Connection Inspection for Sewer and Water	Yes	J. Nicolay, J. Bruyere, G. Wiedenhoef
Idylwild Drive - 1271	17-Sep-18	Water	Water Turn Off/On	Turn water off for winter @ 9/17 - 8am	Yes	J. Bruyere
Victoria Ave N - 911	19-Sep-18	Water	New Water Service Installations	CCTV & connection Inspection for Sewer and Water	Yes	J. Bruyere, G. Wiedenhoef
Fourth St. E - 906	21-Sep-18	Sewer	Plugged Sewers	Couldn't get to back up. Cleaned service line @ owners request	Yes	G. Wiedenhoef / J. Bruyere
Scott St. - 330	21-Sep-18	Water	Curb Stop Box Adjustments	Replaced c/s top and sleeve; set to grade	No	B. Patterson / J. Nicolay
Scott St. - 334	21-Sep-18	Water	Curb Stop Box Adjustments	Replaced c/s top and sleeve; set to grade	No	B. Patterson / J. Nicolay
Scott St. - 306 (300/302)	21-Sep-18	Water	Curb Stop Box Adjustments	Replaced c/s top and sleeve; lowered to grade; 306 fed from 302.	No	B. Patterson / J. Nicolay
Scott St. - 314	21-Sep-18	Water	Curb Stop Box Adjustments	Replaced c/s top and sleeve; set to grade	No	B. Patterson / J. Nicolay
Scott St. - 318	21-Sep-18	Water	Curb Stop Box Adjustments	Curb Stop Box Adjustments	No	B. Patterson / J. Nicolay
Scott St. - 324	21-Sep-18	Water	Curb Stop Box Adjustments	Replaced c/s top and sleeve; set to grade	No	B. Patterson / J. Nicolay
Scott St. - 300/302	21-Sep-18	Water	Curb Stop Box Adjustments	Replaced c/s top and sleeve; set to grade	No	B. Patterson / J. Nicolay
Strachan Place - 1208	21-Sep-18	Water	Water Turn Off/On	Replaced c/s top and sleeve; lowered to grade	No	B. Patterson / J. Nicolay
Riverview Cemetery	21-Sep-18	Water	Water Turn Off/On	Turn water off for repairs	Yes	J. Bruyere
Third St. E - 429	24-Sep-18	Water	Water Turn Off/On	Turn water off for winter	No	J. Nicolay
	25-Sep-18	Sewer	Miscellaneous Works	Replaced fernco on cleanout in yard	No	
				Ran roter. Hit obstruction @ 8ft. Water went. Roots and wipes back on knife. Ran to main and clear.	Yes	G. Wiedenhoef / J. Nicolay
Scott St. - 330	25-Sep-18	Sewer	Plugged Sewers	Turn water on @ 1:00pm, test fitting, turn water off	Yes	G. Wiedenhoef
Strachan Place - 1208	25-Sep-18	Water	Water Turn Off/On			
Scott St. - 340	26-Sep-18	Water	Curb Stop Box Adjustments	Replaced c/s box and rod.	No	G. Wiedenhoef / J. Nicolay
Scott St. - 338	27-Sep-18	Water	Curb Stop Box Adjustments	Replaced c/s box and rod.	No	G. Wiedenhoef / J. Nicolay
Huffman Court - 837	27-Sep-18	Water	Water Turn Off/On	Turn water on @ 12:15pm	Yes	G. Wiedenhoef
Victoria Ave - 839	28-Sep-18	Other	Private Work	CCTV existing sewer - not satisfactory for use.	Yes	B. Patterson / J. Nicolay

Count of Subcategory

Breakdown of Work Completed in September

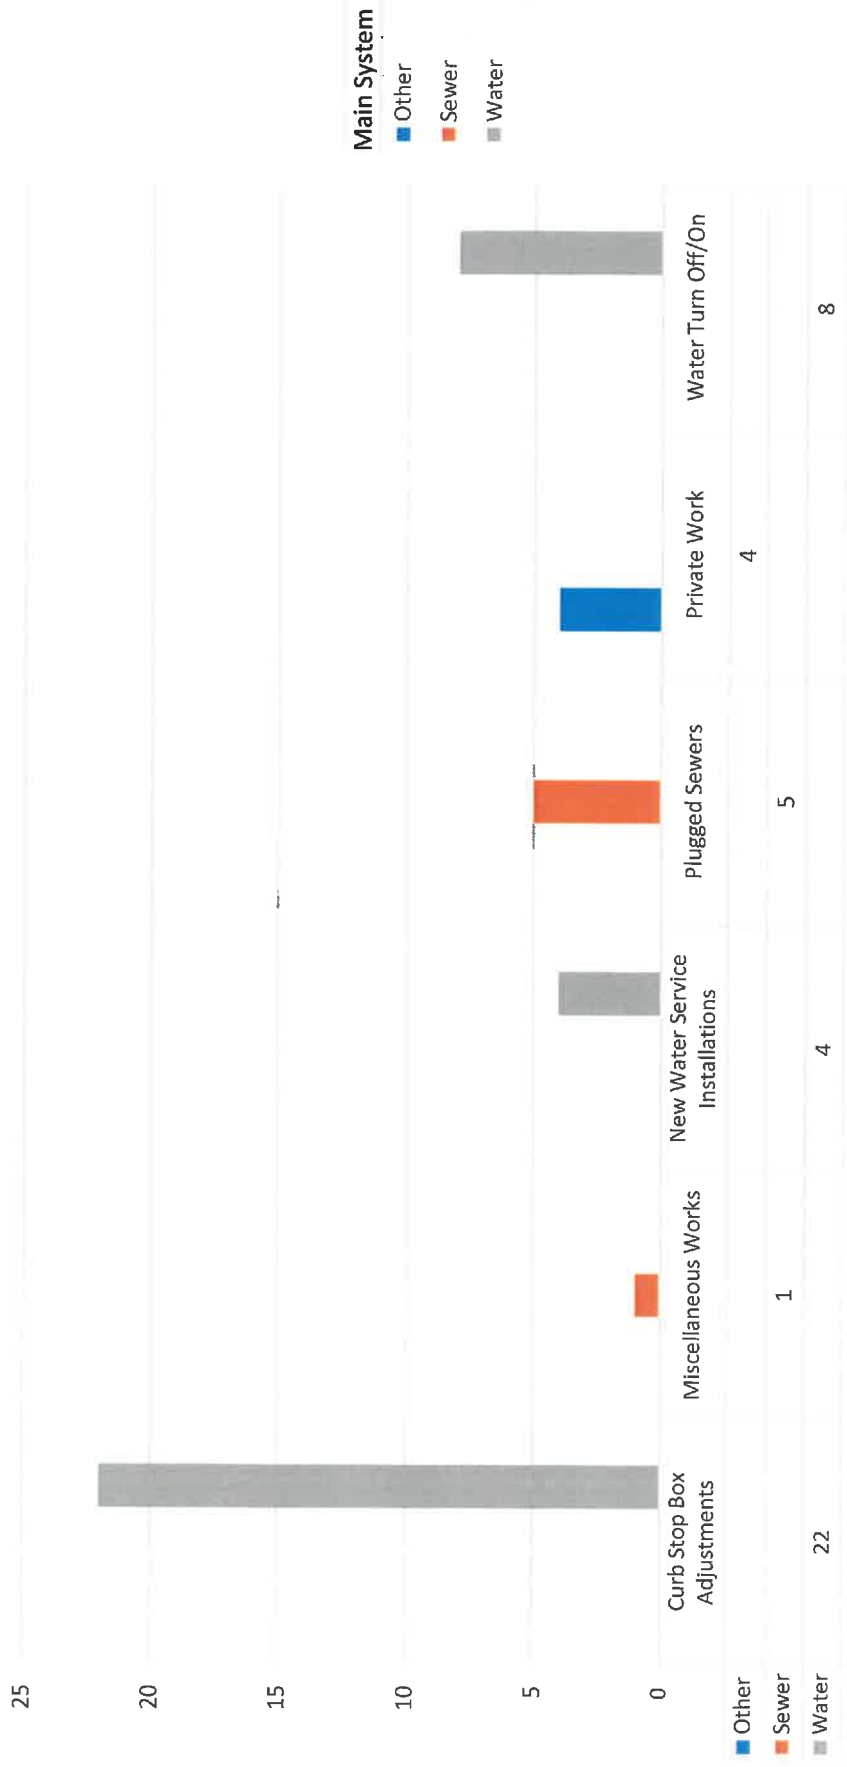

Subcategory